

CircuitSolver® with Thermometer
[Thermostatic balancing valve with thermometer]
SUBMITTAL

JOB:	ORDER NO:	DATE:
	SUBMITTED BY:	DATE:
UNIT TAG:	APPROVED BY:	DATE:
CITY:	ENGINEER:	BUILDING TYPE:
STATE:	CONTRACTOR:	CONSTRUCTION TYPE:
COMPLETION DATE:		

DESCRIPTION

CircuitSolver® is a self-acting thermostatic recirculation valve which automatically and continuously maintains the end of each domestic hot water supply line at the specified water temperature. Since the CircuitSolver® responds to water temperature and controls flow to the return, it eliminates the need to manually balance the system.

Item No.	Part Number	Description	Qty.
1	258-200000-XXX	½" CIRCUITSOLVER® THERMOSTATIC BALANCING VALVE	1
2	92-162	½" X CL NIPPLE BRS LF	1
3	93-172	½" REDUCING TEE	1
4	93-094	THERMOWELL	1
5	94-287	THERMOMETER	1

*ALL COMPONENTS ARE LEAD FREE


Item No.	Part Number	Description	Qty.
1	258-300000-XXX	¾" CIRCUITSOLVER® THERMOSTATIC BALANCING VALVE	1
2	92-026	¾" X CL NIPPLE BRS LF	1
3	93-173	¾" X ½" REDUCING TEE	1
4	93-094	THERMOWELL	1
5	94-287	THERMOMETER	1

*ALL COMPONENTS ARE LEAD FREE

Item No.	Part Number	Description	Qty.
1	258-400000-XXX	1" CIRCUITSOLVER® THERMOSTATIC BALANCING VALVE	1
2	92-044	1" X CL NIPPLE BRS LF	1
3	93-174	1" X ½" REDUCING TEE	1
4	93-094	THERMOWELL	1
5	94-287	THERMOMETER	1

*ALL COMPONENTS ARE LEAD FREE

DIMENSIONS

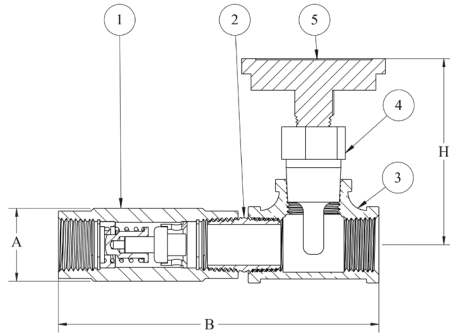

		Diameter (A)		Length (B)		Height (H)		Weight		C _v		Max. Pressure		Max. Temp.	
Model No.	NPT	IN	MM	IN	MM	IN	MM	LBS.	KG	OPEN	CLOSED	PSIG	BAR	°F	°C
CS- ½ -XXX-T	½"	1.1	29	5	127	2.9	74	1.1	0.5	1.3	0.1	200	14	300	149
CS- ¾ -XXX-T	¾"	1.4	35	5.6	142	3.0	76	1.5	0.7	1.8	0.1				
CS-1 -XXX-T	1"	1.8	44	6.2	156	3.1	79	2.6	1.2	3.3	0.15				


Model Number Selection

XXX refers to the desired closing temperature. When the water temperature drops below this point the CircuitSolver® will begin to open, allowing water to easily enter the return line. For example, if you want 120°F desired return temperature and the CircuitSolver® is to be installed on a ¾" line, the model number would be CS-3/4-120-T.

FLOW RATE CALCULATION USING "CV" FACTOR SHOWN IN TABLE ABOVE (FOR WATER G = 1.0)

$$GPM = C_v \sqrt{\frac{\Delta P}{G}} \quad C_v = \sqrt{\frac{GPM}{\Delta P}} \quad \Delta P = \left[\frac{GPM}{C_v} \right]^2 G$$

MATERIALS

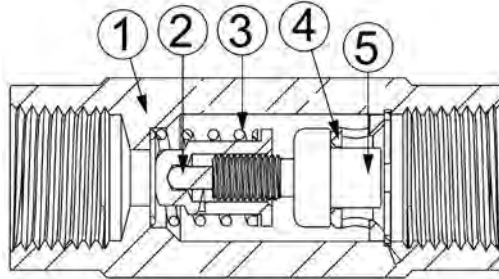

ITEM	DESCRIPTION	MATERIAL
1	Valve Body	303 stainless steel
2	Valve Plug	303 stainless steel
3	Spring	302 stainless steel
4	Carrier	303 stainless steel
5	Thermal Actuator	303 stainless steel

TYPICAL SPECIFICATION

- I. Furnish and install CIRCUITSOLVER® as indicated on the plans. CIRCUITSOLVER® shall be self contained and fully automatic without additional piping or control mechanisms. Valve shall be a CIRCUITSOLVER® as manufactured by ThermOmegaTech®, Inc., or equivalent.
 - A. CIRCUITSOLVER® shall regulate the flow of recirculated domestic hot water based on water temperature entering the CIRCUITSOLVER® regardless of system operating pressure.
 1. Even when fully closed the CIRCUITSOLVER® shall bypass a small amount hot water to maintain dynamic control of the recirculating loop.
 2. CIRCUITSOLVER® shall be factory adjustable as required by project conditions.
 3. CIRCUITSOLVER® shall be available in sizes ranging from ½" NPT to 2" NPT.
- II. CIRCUITSOLVER® body and all internal components shall be constructed of stainless steel with major components constructed of type 303 stainless steel.
 - A. CIRCUITSOLVER® sizes ½" through 2" shall be rated to 200 PSIG maximum working pressure.
 1. All CIRCUITSOLVER® shall be standard tapered female pipe thread, NPT.
 - B. All CIRCUITSOLVER® shall be rated to 300°F (148.9°C) maximum working temperature.
 - C. All CIRCUITSOLVER® shall be NSF-61 certified for use in all domestic water systems.
 - D. Thermal actuator shall be spring loaded and self cleaning, delivering closing thrust sufficient to keep orifice opening free of scale deposits.
- III. Installation of CIRCUITSOLVER® shall be made by qualified tradesmen. Install CIRCUITSOLVER® in each domestic hot water return piping branch beyond last hot water device in that branch.
 - A. Provide suitable line size isolation valves, unions, and strainer as indicated in piping detail shown on the drawings.
 - B. Provide suitable access panel as required in non-accessible ceilings and walls.